

---

**MONOCHIP THREE PHASE BIDIRECTIONAL  
KILOWATT HOUR METERING MODULE**

---

**FEATURES**

- Performs bidirectional energy metering and includes a 7 digit LCD driver with annunciators
- 4 externally selectable on-chip tariff registers
- An additional total energy register
- Meets the accuracy requirements for Class 1 AC Watt hour meters
- Optical interface for electronic reading
- according to IEC1107 Mode D
- Pulse output for calibration
- Total power consumption rating below 100mW
- Uses current transformers for current sensing
- Operates over a wide temperature range
- Demonstration software included

**DESCRIPTION**


The SAMES monochip three phase bidirectional kilowatt hour metering module, the PM9110BF, provides all the required metering functions including energy measurement, a 7 digit LCD driver, a tariff selection facility, an optical port as well as a pulse output for calibration purposes.

Energy consumption is determined by the power measurement being integrated over time.

This method of calculation takes the power factor into account.

This application utilises the SAMES SA9110AFA monochip three phase bidirectional kilowatt hour metering IC for energy measurement.

**BLOCK DIAGRAM**

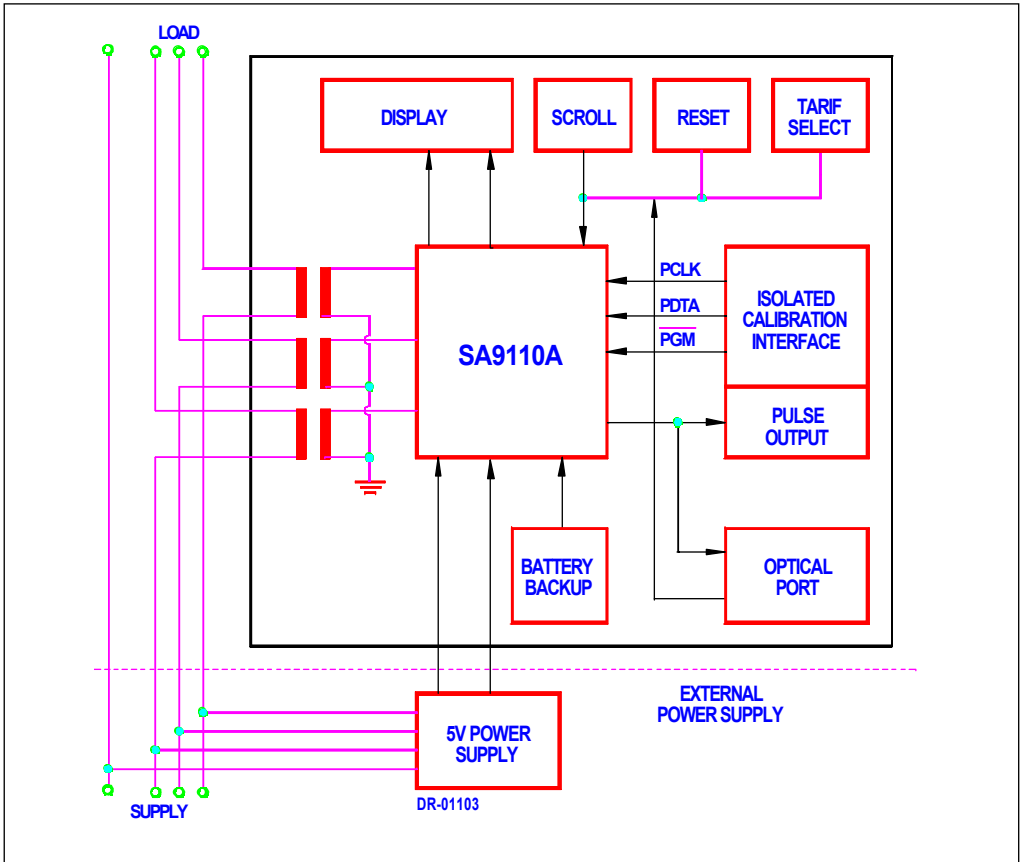

**ABSOLUTE MAXIMUM RATINGS\***

Parameter	Symbol	Min	Max	Unit
Supply Voltage (Note 1)	$V_{AC}$		540	V
Storage Temperature	$T_{STG}$	-25	+125	°C
Operating Temperature	$T_O$	-10	+70 (Note 2)	°C

Note 1: Voltages are specified with reference to Neutral

Note 2: The SA9110A integrated circuit is specified to operate over the temperature range -10°C to +70°C. The module functionality will, however, depend upon the external components used.

\*Stresses above those listed under “Absolute Maximum Ratings” may cause permanent damage to the device. This is a stress rating only. Functional operation of the device at these or any other conditions above those indicated in the operational sections of this specification, is not implied. Exposure to Absolute Maximum Ratings for extended periods may affect device reliability.

**ELECTRICAL CHARACTERISTICS**

(Over the temperature range -10°C to +70°C, unless otherwise specified. Power consumption figures are applicable to the PM9110BFE only.)

Parameter	Symbol	Min	Typ	Max	Unit	Condition
Supply Voltage (x3 Phase) (Continuous)	$V_{AC}$	180	230	265	V	PM9110BFE
Power Consumption				100	mW	From external power supply
Isolation Voltage <sup>1</sup>	$V_{IS}$			2500	V	Continuous
Opto-coupler Output Current	$I_O$			10	mA	$V_{OL} = 1V$
Opto-coupler Input Current	$I_I$			10	mA	

Note 1: Isolation voltage may be specified, depending on customer requirements.

**PIN DESCRIPTION**

Designation	Description
SK1 5-Pin Header connector	Isolated programming interface
SK2 2-Pin Header connector	Isolated pulse output
MAINS	Voltage Supply Connected to Phase 1 Voltage Supply Connected to Phase 2 Voltage Supply Connected to Phase 3 Voltage Supply Connected to Neutral Line (common)
CT1 CT2 CT3	Phase 1 (Orientation indicated on PCB) Phase 2 (Orientation indicated on PCB) Phase 3 (Orientation indicated on PCB)
POWER	5V DC Supply Voltage 0V DC Supply Voltage

**FUNCTIONAL DESCRIPTION****1. Energy Calculation**

This Application Note should be read in conjunction with the SA9110A Data Sheet.

In the Application Circuit (see Figure 2), the output current from the current sensors will be between 0 and  $16\mu\text{A}_{\text{RMS}}$ . The current input stage of the module saturates at input currents greater than  $18\mu\text{A}_{\text{RMS}}$ . The mains voltage (Voltage + 15% - 20%) is used to perform the energy calculation, together with the current information from the current sensor (current transformers).

The SA9110AFA integrated circuit may be adjusted to accommodate any voltage or current values. The method for calculating external component values is described in section 9 (Circuit Description).

The accumulated energy is directly displayed on a 7 digit LCD. This unique application offers a host of additional features, which are dealt with below.

**2. Electrostatic Discharge (ESD) Protection**

The device's inputs/outputs are protected against ESD. The module's resistance to transients will be dependant upon the protection components used.

**3. Power Consumption**

The overall power consumption rating for this power metering application (Figure 2), is under 100mW, excluding the current sensors.

**4. Isolation**

The programming interface and pulse output are isolated from the module which is at mains potential, via opto-couplers.

**5. Isolated Programming Interface**

This isolated interface is provided to allow the user to programme the tariff register values, calibration constants and manufacturer/meter identification codes. This port is enabled by inserting the jumpers J8, J9 and J10. The programming may be performed via the parallel port of a personal computer.

The designation of the pins on connector SK1 are given below:

PM9110BF		PC Parallel Connectors (Suggested)	
Pin	Description	Pin	Description
1	GND	18	GND
2	PB	2	D1
3	PCLK	4	D3
4	PDTA	5	D4
5	PGM	3	D2

**Note:** The recommended connections above are applicable for the demonstration software provided with the PM9110BF.

## 6. Optical Port

The optical port has been designed to meet the IEC1107 Mode D specification. This facility offers a pulse output as well as a serial data meter reading facility.

Three types of interfacing elements from the PM9110BF are available:

- a) Infra-red optical port
- b) Red LED
- c) Opto-coupler

In order to maximise the intensity of the element, it is suggested that only one of the outputs be used at any one time.

Jumper	Element
J5	Opto Coupler
J6	Infra Red LED
J7	Red LED

## 7. Liquid Crystal Display (LCD)

The PM9110BF has a LCD comprising of seven digits with annunciators.

To cater for compatibility with future devices four jumpers are provided for backplane driving configurations. The PM9110BF boards are shipped to the customer with jumpers in a default configuration.

## 8. Tariff, Scroll and Reset Functions

### *Tariff Selection*

A dual DIP switch provides the user with the facility to set the active tariff register in which consumption will be accumulated.

The active register is indicated on the LCD.

### *Scroll Facility*

The 4 registers may be sequentially displayed by activating the scroll button. The contents of the register selected for display is retained on the display for a period of 10 seconds, provided that the push button is not activated during this period. After the 10 seconds has elapsed, the display defaults to the "active" register defined by the status of the tariff DIP switches.

The register selected for display via the scroll button is indicated by the relevant annunciators.

### *Reset Function*

By pressing the Reset button the contents of the RAM of the SA9110A device is set to the default conditions.

Jumpers J8, J9 and J10 must be removed to use this feature.

It is strongly recommended that the provision of this facility is not made available on production meters.

## **9. Circuit Description**

The module is supplied from an external 5V DC supply.

The most important external components are:

$C_7$ ,  $C_9$ ,  $C_{10}$  and  $C_{11}$  are the outer loop capacitors for the integrated oversampling A/D converters. The typical value of  $C_7$  is 2.2nF and the value of  $C_9$ ,  $C_{10}$  and  $C_{11}$  is 560pF.

The actual values determine signal to noise and stability performance. The tolerances should be within  $\pm 10\%$ .

$C_4$ ,  $C_5$ ,  $C_6$  and  $C_8$  are the inner loop capacitors for the integrated oversampling A/D converters. The typical value of  $C_4$ ,  $C_5$ ,  $C_6$  and  $C_8$  is 3.3nF. Values smaller than 0.5nF and larger than 5nF should be avoided.

Terminated current sensors (current transformers) are connected to the current sensor inputs of the SA9110A through current setting resistors ( $R_8$ ,  $R_{13}$ ).

The resistor values should be selected for an input current of  $16\mu A_{RMS}$  into the SA9110A at the rated line current.

The values of these resistors should be calculated as follows:

Phase 1:

$$R_8 = R_9 = (I_{L1}/16\text{mA}) * R_{18}/2$$

Phase 2:

$$R_{10} = R_{11} = (I_{L2}/16\text{mA}) * R_{19}/2$$

Phase 3:

$$R_{12} = R_{13} = (I_{L3}/16\text{mA}) * R_{20}/2$$

Where  $I_{LX}$  = Secondary CT current at rated conditions.

$R_{18}$ ,  $R_{19}$  and  $R_{20}$  = Termination resistors of the three current transformers.

$R_{1A} + R_{1B}$ ,  $R_4$  and  $R_{15}$  set the current for the phase 1 voltage sense input.  $R_{2A} + R_{2B}$ ,  $R_5 + P_5$  and  $R_{16}$  set the current for phase 2 and  $R_{3A} + R_{3B}$ ,  $R_6 + P_6$  and  $R_{17}$  set the current for phase 3. The values should be selected so that the input currents into the voltage sense inputs (virtual ground) are set to  $14\text{mA}_{\text{RMS}}$  for rated line voltage. Capacitors C1, C2 and C3 are for decoupling and phase compensation.

$R_7$  defines all on-chip bias and reference currents. With  $R_7 = 24\text{k}\Omega$ , optimum conditions are set. Any changes to  $R_7$  will affect the output quadratically (i.e:  $\Delta R = +5\%$ ,  $\Delta f = +10\%$ ).

XTAL is a colour burst TV crystal ( $f = 3.5795\text{MHz}$ ) for the oscillator. The oscillator frequency is divided down to  $1.7897\text{MHz}$  on-chip and supplies the A/D converters and the digital circuitry.

## 10. Demonstration Software

Serial communication with the SA9110A device is identical to the communication found on the Single Phase family member, SA9109A. For this reason the demonstration software for the Single Phase Application circuit is used for the Three Phase Application.

The software package which accompanies the demonstration unit requires an IBM or compatible PC with MS-DOS installed. This software, supplied on a  $1.44\text{M } 3\frac{1}{2}"$  disk, will allow the user to read and write settings from/to the demonstration unit.

Ensure that the communication connectors are in place prior to start.

Insert the diskette into the drive and at the DOS prompt, type `A : SA9109 [enter]`

Context sensitive help screen for each input field or command prompt are available by invoking `[alt] H` or `[F1]` key.

An introduction is available by pressing the `[F1]` key immediately after installation.

Figure 1: Connection Diagram


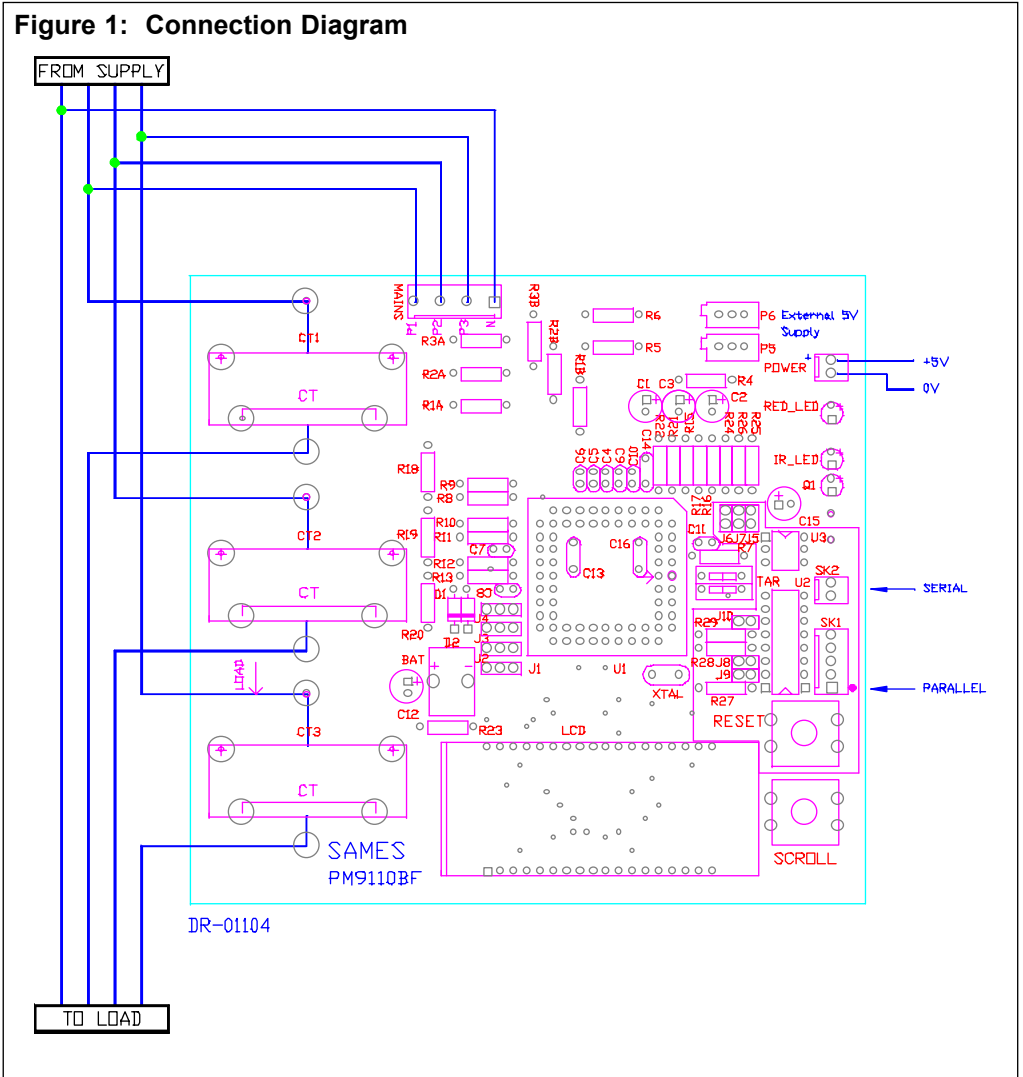




Figure 2: Application Circuit.

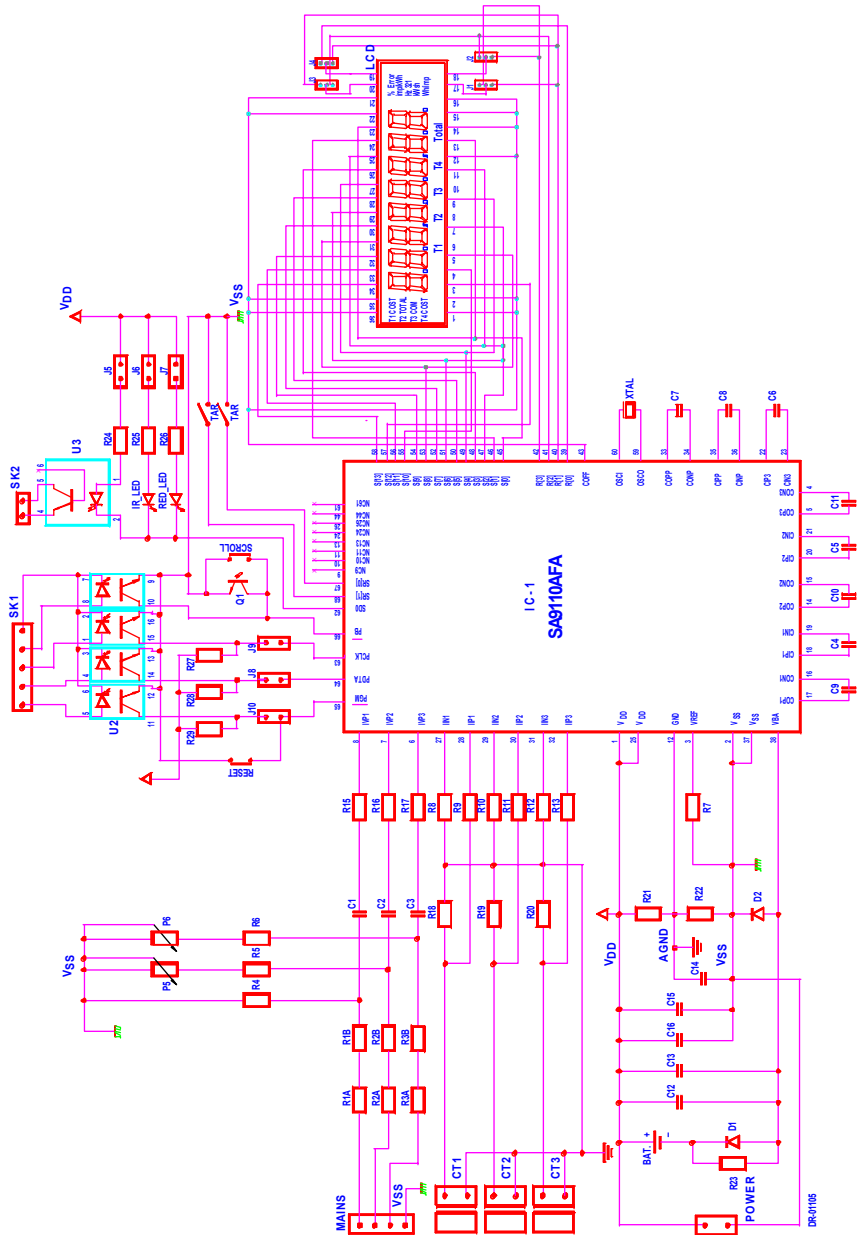

## Parts List for Application circuit: Figure 2

Item	Symbol	Description	Detail
1	U1	SA9110AFA	PLCC-68
2	U2	ILQ74 (Quad opto-coupler)	DIP-16
3	U3	4N35 (opto-coupler)	DIP-6
4	XTAL	Crystal 3.5795MHz	Colour burst TV
5	R1A	Resistor, 1%, 1/4W, metal	Note 4
6	R1B	Resistor, 1%, 1/4W, metal	Note 4
7	R2A	Resistor, 1%, 1/4W, metal	Note 4
8	R2B	Resistor, 1%, 1/4W, metal	Note 4
9	R3A	Resistor, 1%, 1/4W, metal	Note 4
10	R3B	Resistor, 1%, 1/4W, metal	Note 4
11	R4	Resistor, 24k, 1%, 1/4W, metal	
12	R5	Resistor, 22k, 1%, 1/4W, metal	
13	R6	Resistor, 22k, 1%, 1/4W, metal	
14	R7	Resistor, 24k, 1%, 1/4W, metal	
15	R8	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
16	R9	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
17	R10	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
18	R11	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
19	R12	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
20	R13	Resistor, 2.7k, 1%, 1/4W, metal	Note 1
21	R15	Resistor, 1M, 1%, 1/4W, metal	
22	R16	Resistor, 1M, 1%, 1/4W, metal	
23	R17	Resistor, 1M, 1%, 1/4W, metal	
24	R18	Resistor, 2.7Ω, 1%, 1/4W, metal	Note 1
25	R19	Resistor, 2.7Ω, 1%, 1/4W, metal	Note 1
26	R20	Resistor, 2.7Ω, 1%, 1/4W, metal	Note 1
27	R21	Resistor, 820Ω, 1%, 1/4W, metal	
28	R22	Resistor, 820Ω, 1%, 1/4W, metal	
29	R23	Resistor, 2MΩ, 1%, 1/4W, metal	
30	R24	Resistor, 680Ω, 1%, 1/4W, metal	
31	R25	Resistor, 2.2kΩ, 1%, 1/4W, metal	
32	R26	Resistor, 2.2kΩ, 1%, 1/4W, metal	
33	R27	Resistor, 2.2kΩ, 1%, 1/4W, metal	
34	R28	Resistor, 2.2kΩ, 1%, 1/4W, metal	
35	R29	Resistor, 2.2kΩ, 1%, 1/4W, metal	
36	P5	Potentiometer, 4.7kΩ	Multi turn
37	P6	Potentiometer, 4.7kΩ	Multi turn
38	C1	Capacitor, electrolytic, 1μF, 16V	Note 2
39	C2	Capacitor, electrolytic, 1μF, 16V	Note 2
40	C3	Capacitor, electrolytic, 1μF, 16V	Note 2
41	C4	Capacitor, ceramic, 3.3nF	
42	C5	Capacitor, ceramic, 3.3nF	
43	C6	Capacitor, ceramic, 3.3nF	

## Parts List for Application circuit: Figure 2 (continued)

Item	Symbol	Description	Detail
44	C7	Capacitor, ceramic, 2.2nF	
45	C8	Capacitor, ceramic, 3.3nF	
46	C9	Capacitor, ceramic, 560pF	
47	C10	Capacitor, ceramic, 560pF	
48	C11	Capacitor, ceramic, 560pF	
49	C12	Capacitor, 100 $\mu$ F, 16V	
50	C13	Capacitor, 100nF	Note 3
51	C14	Capacitor, 100nF	Note 3
52	C15	Capacitor, 100 $\mu$ F, 16V	
53	C16	Capacitor, 820nF	
54	BAT	Battery, 1.2V	
55	IR LED	Infrared light emitting diode	
56	RED LED	Red light emitting diode	
57	Q1	Photo transistor	
58	D1	Diode, 1N4148	
59	D2	Diode, 1N4148	
60	SCROLL	NO, push button	
61	RESET	NO, push button	
62	TARIFF	DIP switch, 2 pole	
63	LCD	OEL-7678*	

Note 1: Resistor ( $R_8$ ,  $R_9$ ,  $R_{10}$ ,  $R_{11}$ ,  $R_{12}$  and  $R_{13}$ ) values are dependant upon the selected values of the current transformer termination resistors  $R_{18}$ ,  $R_{19}$  and  $R_{20}$

Note 2: Capacitor values may be selected to compensate for phase errors caused by the current transformers

Note 3: Capacitor (C13) to be positioned as close to Supply Pins ( $V_{DD}$  &  $V_{SS}$ ) of IC-1, as possible

Note 4: See the table below detailing the component values for the selected voltage standard

\*The LCD display is available from:  
 JEBON CORPORATION  
 Unit 709, Poongsan Factoria Town,  
 1141-2, Baegsok-Dong, Ilsan-District,  
 Koyangcity, Kyonggi-Do, 411-360, Korea  
 Tel: +82-31-902-9161 (12 lines)  
 Fax: +82-31-902-7775/7776

Web site: <http://www.jebon.com>

Item	Symbol	Description		Detail
		PM9110BFE 230V	PM9110BFA 115V	
5	R1A	200k $\Omega$	120k $\Omega$	
6	R1B	180k $\Omega$	82k $\Omega$	
7	R2A	200k $\Omega$	120k $\Omega$	
8	R2B	180k $\Omega$	82k $\Omega$	
9	R3A	200k $\Omega$	120k $\Omega$	
10	R3B	180k $\Omega$	82k $\Omega$	

**ORDERING INFORMATION**

Part Number	Description
PM9110BFA	3 X 115V, 3 X 80A Module
PM9110BFE	3 X 230V, 3 X 80A Module

Notes:



**Disclaimer:** The information contained in this document is confidential and proprietary to South African Micro-Electronic Systems (Pty) Ltd ("SAMES") and may not be copied or disclosed to a third party, in whole or in part, without the express written consent of SAMES. The information contained herein is current as of the date of publication; however, delivery of this document shall not under any circumstances create any implication that the information contained herein is correct as of any time subsequent to such date. SAMES does not undertake to inform any recipient of this document of any changes in the information contained herein, and SAMES expressly reserves the right to make changes in such information, without notification, even if such changes would render information contained herein inaccurate or incomplete. SAMES makes no representation or warranty that any circuit designed by reference to the information contained herein, will function without errors and as intended by the designer.

Any Sales or technical questions may be posted to our e-mail address below:  
[energy@sames.co.za](mailto:energy@sames.co.za)

For the latest updates on datasheets, please visit our web site:  
<http://www.sames.co.za>

### **South African Micro-Electronic Systems (Pty) Ltd**

P O Box 15888,  
Lynn East, 0039  
Republic of South Africa,

33 Eland Street,  
Koedoespoort Industrial Area,  
Pretoria,  
Republic of South Africa

Tel: 012 333-6021  
Fax: 012 333-8071

Tel: Int +27 12 333-6021  
Fax: Int +27 12 333-8071

