


POWER-UNITS No.53A AND No.53B

10V 0.25A DC

SUPPLY FROM 50Hz AC MAINS

N 631
ISSUE E

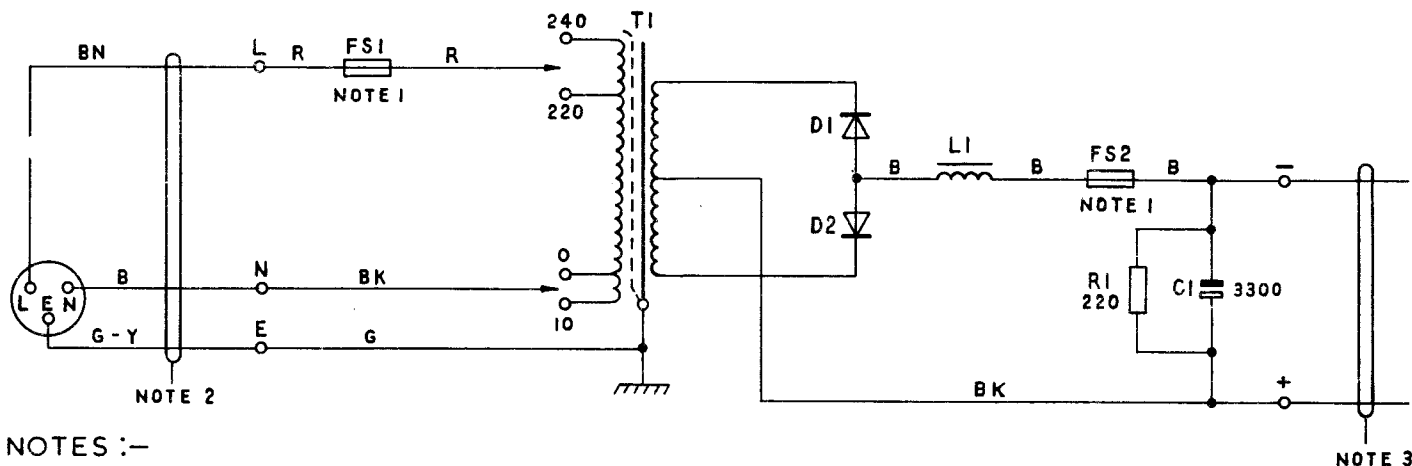

NOTES :-

1. FS1 - FUSE No. 36A/0.1 FS2 - FUSE No. 36/0.5
2. CORD FLEXIBLE 3183Y 0.75mm² AND BS 3 PIN PLUG TO SUIT SOCKET TO BE REQUISITIONED SEPARATELY AND FITTED LOCALLY FUSED PLUGS TO BE FITTED WITH 3 AMP FUSES
3. CABLE DISTRIBUTION 3595 REQUISITIONED SEPARATELY AND FITTED LOCALLY
4. THE OUTPUT MUST NOT BE EARTHED

| | | | |
|---|---|---|---------|
| PO TELECOMMS HQRS PAPER :-W DISTN :- GENERAL | | | |
| | E | NEW FORMAT. TRANSFORMER 200V TAPPING REMOVED WIRE COLOURS AND CAPACITOR VALUE CHANGED. NOTES 2 & 3 AMENDED. NOTE 4 ADDED. 53B INTRODUCED D.L.W. TD 7.2.3 | 12.4.77 |
| | D | NEW FORMAT KMA | 12.7.66 |